

Phone No-080-29761529
Email Id- rfosouthblr@gmail.com

No.135/Education/CC/RFO/Bng-South/2026

Dated: 20-06-2026

 $\lambda,$

Authorized Signatory,
M/s. Bangalore International Kids High,
No.20/A, 1st Main, Saphthagiri Layout,
Uttarahalli Road, Subramanyapura,
Bengaluru - 560 061.

ಮಾನ್ಯರೇ,

ವಿಷಯ : M/s. Bangalore International Kids High, ನಂ 20/ಎ, 1 ನೇ ಮೇನ್, ಸಪ್ತಗಿರಿ ಲೇಔಟ್, ಉತ್ತರಹಳ್ಳಿ ರಸ್ತೆ, ಸುಬ್ರಮಣ್ಯಮಠ, ಬೆಂಗಳೂರು-560 061. ಇಲ್ಲಿ ನಿರ್ಮಿಸಿರುವ ಕಟ್ಟಡಕ್ಕೆ ಸಮಾಪನ ಪತ್ರ ನೀಡುವ ಬಗ್ಗೆ.


ಉಲ್ಲೇಖ : 1) ಸಲಹಾ ಪತ್ರ ಸಂ.118/Education/FSR/RFO/Bng-South/2026
ದಿನಾಂಕ: 02-06-2026.
2) ನಿಮ್ಮ ಪತ್ರ ದಿನಾಂಕ: 18-06-2026.

<<<<<<<>>>>>>>>

ನಂ 20/ಎ, 1 ನೇ ಮೇನ್, ಸಪ್ತಗಿರಿ ಲೇಔಟ್, ಉತ್ತರಹಳ್ಳಿ ರಸ್ತೆ, ಸುಬ್ರಹ್ಮಣ್ಯಪುರ, ಬೆಂಗಳೂರು-560 061. ಇಲ್ಲಿ ನಿರ್ಮಿಸಿರುವ 18.50 ಮೀಟರ್ ಎತ್ತರದ ಕೆಳಹಂತ, ನೆಲಹಂತ ಮತ್ತು 04 ಮೇಲಂತಸ್ತುಗಳನ್ನು ಹೊಂದಿರುವ M/s. Bangalore International Kids High, ಶೈಕ್ಷಣಿಕ ಕಟ್ಟಡಕ್ಕೆ ಅಗ್ನಿಶಾಮಕ ಮತ್ತು ತುರ್ತು ಸೇವಾ ಇಲಾಖೆಯಿಂದ ಈ ಮೇಲಿನ ಉಲ್ಲೇಖ (1) ರಂತೆ ದಿನಾಂಕ:02-06-2026 ರಂದು ನಿಮ್ಮ ಕೋರಿಕೆಯಂತೆ ಅಗ್ನಿಶಮನ ಸಲಹಾ ಪತ್ರ ನೀಡಲಾಗಿದೆ.

ಉಲ್ಲೇಖ (2) ರ ನಿಮ್ಮ ಪತ್ರದಲ್ಲಿ, ಸದರಿ ಶೈಕ್ಷಣಿಕ ಕಟ್ಟಡದಲ್ಲಿ ಅಗ್ನಿಶಮನ ಉಪಕರಣಗಳ ಅಳವಡಿಕೆ ಕಾರ್ಯ ಮುಗಿದಿದ್ದು, ಅಗ್ನಿಶಾಮಕ ಮತ್ತು ತುರ್ತು ಸೇವಾ ಇಲಾಖೆಯ ಸಮಾಪನ ಪತ್ರ ನೀಡುವಂತೆ ಕೋರಿರುವಿರಿ.

ನಿಮ್ಮ ಕೋರಿಕೆಯಂತೆ, ಜಿಲ್ಲಾ ಅಗ್ನಿಶಾಮಕ ಅಧಿಕಾರಿ, ಬನಶಂಕರಿ ಅಗ್ನಿಶಾಮಕ ಠಾಣೆ, ಕರ್ನಾಟಕ ಅಗ್ನಿಶಾಮಕ ಮತ್ತು ತುರ್ತು ಸೇವೆಗಳು ರವರು ದಿನಾಂಕ: 19-06-2026 ರಂದು ನಂ 20/ಎ, 1 ನೇ ಮೇನ್, ಸಪ್ತಗಿರಿ ಲೇಔಟ್, ಉತ್ತರಹಳ್ಳಿ ರಸ್ತೆ, ಸುಬ್ರಮಣ್ಯಪುರ, ಬೆಂಗಳೂರು-560 061 ಇಲ್ಲಿ ನಿರ್ಮಿಸಿರುವ ಶೈಕ್ಷಣಿಕ ಕಟ್ಟಡವನ್ನು ಪರಿವೀಕ್ಷಣೆ ಮಾಡಿ ಅಗ್ನಿಶಾಮಕ ಮತ್ತು ತುರ್ತು ಸೇವಾ ಇಲಾಖೆಯು ನೀಡಿರುವ ಸಲಹಾ ಪತ್ರದಂತೆ, ಅಗ್ನಿರಕ್ಷಣೆ ಮತ್ತು ನಿಯಂತ್ರಣ, ಅಗ್ನಿ ನಂದಿಸುವ ಉಪಕರಣಗಳ ಅಳವಡಿಕೆ ಹಾಗೂ ರಕ್ಷಣಾ ಕ್ರಮಗಳನ್ನು ಶೈಕ್ಷಣಿಕ ಕಟ್ಟಡದಲ್ಲಿ ಪೂರ್ಣವಾಗಿ ಅನುಷ್ಠಾನಗೊಳಿಸಿರುವುದಾಗಿ ಹಾಗೂ ಸದರಿ ಕಟ್ಟಡದಲ್ಲಿನ ನೌಕರರು/ಸಿಬ್ಬಂದಿಗಳಿಗೆ ಅಗ್ನಿಶಮನ ಕುರಿತ ತರಬೇತಿ ಮಾತ್ರ ಬಾಕಿ ಇರುವುದಾಗಿ ಹಾಗೂ ಸದರಿ ಕಟ್ಟಡದ ಸಮಾಪನ ಪತ್ರ ತರುವಾಯ ಅದರಲ್ಲಿನ ಸಿಬ್ಬಂದಿಗಳಿಗೆ ಅಗ್ನಿಶಮನ ಕುರಿತು ತರಬೇತಿ ವ್ಯವಸ್ಥಿಸಲು ಸಾಧ್ಯವಾಗುತ್ತದೆಂದು ತಿಳಿಸಿರುತ್ತಾರೆ.



ಆದ್ದರಿಂದ ನಂ 20/ಎ, 1 ನೇ ಮೇನ್, ಸಪ್ತಗಿರಿ ಲೇಔಟ್, ಉತ್ತರಹಳ್ಳಿ ರಸ್ತೆ, ಸುಬ್ರಮಣ್ಯಪುರ, ಬೆಂಗಳೂರು-560 061. ಇಲ್ಲಿ ನಿರ್ಮಿಸಿರುವ 18.50 ಮೀಟರ್ ಎತ್ತರದ ಕೆಳಹಂತ, ನೆಲಹಂತ ಮತ್ತು 04 ಮೇಲಂತಸ್ತುಗಳನ್ನು ಹೊಂದಿರುವ M/s. Bangalore International Kids High, ಶೈಕ್ಷಣಿಕ ಕಟ್ಟಡಕ್ಕೆ ಅಗ್ನಿಶಾಮಕ ಮತ್ತು ತುರ್ತು ಸೇವಾ ಇಲಾಖೆಯ ಸಲಹಾ ಪತ್ರ ಸಂ.118/Education/FSR/RFO/Bng-South/2026 ದಿನಾಂಕ: 02-06-2026 ರಲ್ಲಿ ತಿಳಿಸಿರುವಂತೆ, ಅಗ್ನಿರಕ್ಷಣೆ ಮತ್ತು ನಿಯಂತ್ರಣ ಹಾಗೂ ಅಗ್ನಿ ನಂದಿಸುವ ಉಪಕರಣಗಳ ಅಳವಡಿಕೆ ಹಾಗೂ ರಕ್ಷಣಾ ಕ್ರಮಗಳನ್ನು ಕಟ್ಟುನಿಟ್ಟಾಗಿ ಪಾಲಿಸಬೇಕೆಂದು ಹಾಗೂ ನಿಮ್ಮ ಮುಚ್ಚಳಿಕೆ ಪತ್ರ ದಿನಾಂಕ 20-06-2026 ರಲ್ಲಿ ಒಪ್ಪಿರುವಂತೆ, ಅಗ್ನಿಶಮನ ಉಪಕರಣಗಳನ್ನು ಸುಸ್ಥಿತಿಯಲ್ಲಿಡಬೇಕೆಂಬ ಹಾಗೂ ಕಟ್ಟಡದಲ್ಲಿನ ಶೇಕಡಾ 40% ರಷ್ಟು ಸಿಬ್ಬಂದಿ/ನೌಕರರಿಗೆ ಅಗ್ನಿರಕ್ಷಣೆ ಮತ್ತು ನಿಯಂತ್ರಣ ಕ್ರಮಗಳ ಬಗ್ಗೆ ಬೆಂಗಳೂರಿನ ಆರ್.ಎ. ಮುಂಡ್ಕೂರ್ ಅಗ್ನಿಶಾಮಕ ಮತ್ತು ತುರ್ತು ಸೇವೆಗಳ ಅಕಾಡೆಮಿಯಲ್ಲಿ ಸೂಕ್ತ ತರಬೇತಿಯನ್ನು 03 ತಿಂಗಳೊಳಗೆ ಪಡೆಯಲು ವ್ಯವಸ್ಥಿಸಬೇಕೆಂಬ ಷರತ್ತಿನ ಮೇಲೆ ಸಮಾಪನ ಪತ್ರವನ್ನು ಅಗ್ನಿಶಾಮಕ ಮತ್ತು ತುರ್ತು ಸೇವೆಗಳ ಇಲಾಖೆಯಿಂದ ನೀಡಲಾಗಿದೆ.

ಈ ಸಮಾಪನ ಪ್ರಮಾಣ ಪತ್ರವು ದಿನಾಂಕ:-01-06-2028 ರವರೆಗೆ ಚಾಲ್ತಿಯಲ್ಲಿರುತ್ತದೆ. ತದನಂತರ ಈ ಸಮಾಪನ ಪತ್ರವನ್ನು ನವೀಕರಿಸುವಂತೆ ತಿಳಿಸಲಾಗಿದೆ.

ಹಾಗೆಯೇ ಒಂದು ವೇಳೆ ಯಾವುದೇ ಸಂದರ್ಭದಲ್ಲಿ ಇಲಾಖೆಯ ಶಿಫಾರಸ್ಸಿನನ್ವಯ ಅಳವಡಿಸಿರುವ ಅಗ್ನಿನಿವಾರಣೆ ಹಾಗೂ ಅಗ್ನಿಶಮನ ಉಪಕರಣಗಳು ಸುಸ್ಥಿತಿಯಲ್ಲಿರದೇ ಇರುವುದು ಕಂಡು ಬಂದರೆ ಅಥವಾ ರಕ್ಷಣಾ ಕ್ರಮಗಳನ್ನು ಕಟ್ಟುನಿಟ್ಟಾಗಿ ಪಾಲಿಸದಿದ್ದರೆ ಅಥವಾ ಕಾನೂನಿನನ್ವಯ ಸದರಿ ಕಟ್ಟಡದ ಸುತ್ತ ಬಿಟ್ಟಿರುವ ತೆರೆದ ಪ್ರದೇಶದಲ್ಲಿ ಯಾವುದೇ ಹೆಚ್ಚುವರಿ ರಚನೆಗಳನ್ನು ನಿರ್ಮಾಣ ಮಾಡಿದರೆ ಅಥವಾ ಯಾವುದೇ ರೀತಿಯ ಖಾಯಂ/ತಾತ್ಕಾಲಿಕ ಅಡಚಣೆಗಳನ್ನು ಉಂಟು ಮಾಡಿದರೆ, ಈ ಸಮಾಪನ ಪತ್ರವು ಅನುರ್ಜಿತಗೊಳ್ಳುವುದು ಹಾಗೂ ಕಾನೂನಿನ ಚೌಕಟ್ಟಿನಲ್ಲಿ ಮುಂದಿನ ಕ್ರಮ ಕೈಗೊಳ್ಳಲಾಗುವುದು ಎಂಬುದಾಗಿ ಸೂಚಿಸಲಾಗಿದೆ.

ಪ್ರಾದೇಶಿಕ ಅಗ್ನಿಶಾಮಕ ಅಧಿಕಾರಿ ^{6/26}
ಬೆಂಗಳೂರು ಹಕ್ಕಣಿ ವಲಯ
ಬನ್ನೇರುಘಟ್ಟ ರಸ್ತೆ, ಬೆಂಗಳೂರು-29

1) ಪ್ರತಿಯನ್ನು ಗೌರವಗಳೊಂದಿಗೆ,

ಮಾನ್ಯ ಪೋಲೀಸ್ ಮಹಾ ನಿರ್ದೇಶಕರು ಹಾಗೂ ಮಹಾ ನಿರ್ದೇಶಕರು,
ಕರ್ನಾಟಕ ರಾಜ್ಯ ಅಗ್ನಿಶಾಮಕ ಮತ್ತು ತುರ್ತು ಸೇವೆಗಳು.

2) ಜಿಲ್ಲಾ ಅಗ್ನಿಶಾಮಕ ಅಧಿಕಾರಿ,

ಬನಶಂಕರಿ ಅಗ್ನಿಶಾಮಕ ಠಾಣೆ
ಬೆಂಗಳೂರು.



No.118/Education/FSR/RFO/Bng-South/2026

Dated: 02-06-2026

To,
Authorized Signatory,
M/s. Bangalore International Kids High,
No.20/A, 1st Main, Sapthagiri Layout,
Uttarahalli Road, Subramanyapura,
Bengaluru - 560 061.

Sir,

Sub: Issue of '**Fire Advisory Certificate**' with respect to fire prevention, fire fighting and evacuation measures required to the Educational Building constructed at M/s. Bangalore International Kids High, No.20/A, 1st Main, Sapthagiri Layout, Uttarahalli Road, Subramanyapura, Bengaluru - 560 061.

Ref: 1) Your request letter dated: 25-05-2026.
2) Inspection report 59/DFO/BFS/FSR-School/2026. Dt:27-05-2026.

With reference to the subject cited above, the District Fire Officer, Banashankari Fire Station, Bengaluru was inspected the Educational building constructed at M/s. Bangalore International Kids High, No.20/A, 1st Main, Sapthagiri Layout, Uttarahalli Road, Subramanyapura, Bengaluru - 560 061 on 27-05-2026 with respect to fire prevention, fire fighting and evacuation measures to be complied in the above premises and submitted the details as follows: -

ANNEXURE-B

"B1 & B2-Schools up to senior secondary level and other institutions"

A. Details of the building / premises :-

1.	Name and address of the applicant	:	Authorized Signatory, M/s. Bangalore International Kids High, No.20/A, 1 st Main, Sapthagiri Layout, Uttarahalli Road, Subramanyapura, Bengaluru - 560 061.
2.	Name and address of the premises.	:	M/s. Bangalore International Kids High, No.20/A, 1 st Main, Sapthagiri Layout, Uttarahalli Road, Subramanyapura,



			Bengaluru - 560 061.
3.	Name and address of the building owner	:	Mr. Rakesh Muniraju, Secretary, M/s. Paramahansa Education Society (Regd.), No.58/2, Subramanyapura Main Road, Chikkallasandra, Bengaluru- 560 061.
4.	Number of Buildings	:	One Building.
5.	Number of floors	:	Basement, Ground & 4 Upper Floors.
6.	<u>Floor wise details of occupancy</u>		
	Basement Floor	:	Empty space.
	Ground Floor	:	Entrance Lobby/ Reception, Pantry, 1 Secretary Room, 1 Conference Room & 2 Class Rooms.
	1 st Floor	:	6 Class Rooms, 1 Principal Office, 1 Staff Room & 1 Store.
	2 nd Floor	:	1 Play Area & Lab Room.
	3 rd Floor	:	3 Class Rooms & Swimming Pool.
	4 th Floor	:	01 Room.
7.	Height of the Building	:	18.50 Mtrs.
8.	Site area	:	2,175.13 Sq.Mtrs.
9.	<u>Built-up area of each floor:-</u>		
	Basement Floor	:	435.00 Sq.Mtrs.
	Ground Floor	:	435.00 Sq.Mtrs.
	1 st Floor	:	435.00 Sq. Mtrs.
	2 nd Floor	:	435.00 Sq.Mtrs.
	3 rd Floor	:	435.00 Sq. Mtrs.
	4 th Floor	:	435.00 Sq.Mtrs.
10.	Total Built up area	:	2,610.00 Sq.Mtrs.
11.	<u>Surroundings of the Property:-</u>		
	North (Front)	:	10.00 Mtrs Wide New Sapthagiri Layout Road.
	South (Rear)	:	Residential Buildings.
	East (Side)	:	08.00 Mtrs Wide Road.
	West (side)	:	Residential Buildings.
12.	<u>Setback area available around the building</u>		
	North (Front)	:	5.00 Mtrs.
	South (Rear)	:	1.00 Mtrs.
	East (Side)	:	1.00 Mtrs.
	West (side)	:	Nil.



Part-B. On inspection of this School premises, the following fire prevention, fire fighting and evacuation measures recommended are considered absolutely essential from fire safety point of view :-

Sl. No. (1)	Details (02)	Existing (03)		Recommendations (04)
1.	Accessibility	The premises is accessible from 10.00 mtrs wide Sapthagiri layout Road, located on the Northern side. The road is hardened to carry the weight of 45,000Kgs.		Complied.
2.	Number of entrances	One Entrance & One Exit have been provided from 10.00 mtrs wide Sapthagiri layout Road, located on the Northern side.		Complied.
3.	Width of entrances	One Entrance of 4.50 mtrs width & One Exit of 5.20 mtrs width have been provided from 10.00 mtrs wide Sapthagiri layout Road, located on the Northern side.		Complied.
4.	Diesel generators	One Diesel Generator of 30 KVA capacity have been provided.		Diesel Generator Should be Connected to all the emergency provisions, Corridor lightings & Fire fighting installations in the building.
5.	Number of staircases available	Number of the staircases	01 No.	---
		Width of staircases	1.50 Mtrs	
		Width of treads	30 Cms.	
		Height of risers	15 Cms.	
		No. of risers per flight	13/09 per flight	
		Height of handrails	0.90 Mtrs.	
		Head room clearance	2.50 Mtrs.	
7.	No. lifts and capacity	No of Lifts Provided.	01	Complied.



		Capacity of Lifts.	8 persons / 544 Kgs Capacity	
6.	Portable Fire extinguishers	Not provided.		Suitable fire extinguishers should be provided as mentioned below. A. One ABC Powder extinguisher of 06kg capacity should be provided for every 100 Sq.mtrs built up area of each floors. B. One CO₂ type of 4.5kg Extinguisher should be Provided for Electrical Panel board, DG Room and Electrical Room.
7.	First aid hose reel hose	One Hose reel hose of minimum 19 mm size of adequate length to reach the farthest point at each floor have been provided with a shut off branch having a nozzle of 5 mm size.		Complied.
8.	Down comer System	Not Provided.		One down comer system should be provided at each floor near each staircase of the building. The system should be of 80 mm internal diameter and of G.I. "C" class pipe. From the Down comer single hydrant outlet should be provided at each landing. Adequate B.I.S marked reinforced rubber lined delivery hoses of 63 mm size to reach the farthest point of the floor/setbacks from the system should be provided with a branch pipe near each hydrant outlet(both internal & external) in a proper box to protect It from withering.
9.	Terrace tank over respective tower terrace	One overhead tank of 5,000 ltrs of water storage capacity has been provided.		Down comer system should be connected to overhead tank (RCC or FRP) /Underground Tank of 10,000 ltrs capacity exclusively for firefighting purpose.



			The Automatic Sprinkler system should be connected to overhead tank (RCC or FRP) /Underground Tank of 10,000 ltrs capacity.
10.	At the terrace tank level/Underground tank level with minimum pressure of 3.5 kg/cm ²	Not Provided.	The system should be connected to booster pump installed at the terrace level /underground tank capable of delivering 450 LPM. The Sprinkler system should be connected to booster pump installed at the terrace level /underground tank capable of delivering 450 LPM.
11.	Automatic sprinkler system.	Not Provided.	Automatic Sprinkler System heads with one sprinkler head for every 6.96 Sq.mtrs in basement area of the building should be provided.
12.	Manually operated electronic Fire alarm system.	Not Provided.	Manually operated electrical fire alarm system with call point should be installed in each floor at appropriate places. The call boxes are of "break glass" type, where the call is transmitted automatically to the control room when the glass of the system is broken. This system should be connected to an alternative source of power supply (diesel generator). The call boxes are so installed that their location can be easily noticed from either direction and at a height of one meter from the floor level.
13.	Public address System	Not Provided.	Public address system with two ways communication facility should be provided, with its console at the control room, located on the ground floor near the entrance of the building.
14.	Fire control room at ground floor.	Not Provided.	Fire control room should be provided at entrance of the ground floor with P.A Console & MCP control panel should be



			installed in fire control room.
15.	Escape routes	Not Provided.	Directions in which the students have to move in the event of any emergency should be displayed in the corridor on each floor during evacuation.
16.	Fire Siren	Not Provided.	A Fire Siren should be installed inside the premises to inform all the inmates in case of a fire emergency and evacuate the area.
17.	No smoking board.	Not Displayed.	COTPA Sec-4, direction NO Smoking area smoking here is an offence board should be written in English & Kannada both language shall be prominently displayed at inside the entry / exit of the each floor.
18.	Nominate one fire Nodal Officer	Not Nominated.	One non-teaching/teaching staff should be nominated as fire nodal officer for the education premises.
19.	Fire order (Fire Safety plans)	Not Displayed.	A notice board have been indicated the action should be taken by the employees in case of any emergency should be displayed with the telephone number of Banashankari Fire Station & 101, 500 550, & 600 and the nearest Ambulance service and Police Station.
20.	Electrical Cables on Termination points in the electrical panel and distribution boxes.	Not Fire Retardant Coated.	Electrical cables on Terminator points in the electrical panel and distribution boxes should be coated with certified Transparent Fire Retardant Coating.
21.	Fire Fighting training	Not Trained.	40% of the staffs/Teachers shall be get trained in fire prevention, fire fighting & evacuation at R.A.Mundkur fire & emergency service Academy, Bannerghatta road, Bengaluru-560 029.
General Fire precautionary measures			



- | | |
|--|---|
| | <p>a. The exit ways shall be kept clear always without any obstructions and the entire exit ways shall be marked with using illuminating paint.</p> <p>b. No fire in any form shall be used in the premises.</p> <p>c. Inflammables and explosive materials shall not be stored in the area.</p> <p>d. 'No Smoking' boards shall be displayed at appropriate places in the premises.</p> <p>e. If gangway shall be provided not less than 01.50mtrs between the record store box rows and wall. The rows space shall be always kept clear.</p> <p>f. The doors shall not be kept locked/ latched during working hours.</p> <p>g. Separate NOC has to be obtained from Department for the storage of Chemicals, Solvents, Petroleum products, LPG, etc in the premises/building.</p> <p>h. This Fire Safety Advisory Certificate is issued from the fire prevention, fire fighting and evacuation measures to the building. Karnataka State Fire & Emergency Services Department is not responsible for the ownership of the land, its location and other disputes, which may arise in due course.</p> <p>i. If any additional construction work is taken up in the building/premises without informed to the department, the Fire Advisory certificate deemed to be cancelled and necessary legal action will be initiated against the developer/management/tenant.</p> |
|--|---|

As such the Karnataka State Fire and Emergency Services department is issuing '**Fire Advisory Certificate**' to the Educational building at M/s. Bangalore International Kids High, No.20/A, 1st Main, Saphthagiri Layout, Uttarahalli Road, Subramanyapura, Bengaluru - 560 061 from **Fire prevention, Fire fighting and Evacuation point of view subject to the compliance of below mentioned conditions within 03 months from the date of issue of Fire Advisory Certificate.**

1. Diesel Generator Should be Connected to all the emergency provisions, Corridor lightings & Fire fighting installations in the building.
2. Suitable fire extinguishers should be provided as mentioned below.
 - A. One ABC Powder extinguisher of 06 kg capacity should be provided for every 100 Sq.mtrs of the built up area of each floors.
 - B. One CO₂ type of 4.5kg Extinguisher should be Provided for Electrical Panel board, DG Room and Electrical Room.
3. One down comer system should be provided at each floor near each staircase of the building. The system should be of 80 mm internal diameter and of G.I. "C" class pipe. From the Down comer single hydrant outlet should be provided at each landing. Adequate B.I.S marked reinforced rubber lined delivery hoses of 63 mm size to reach the farthest point of the floor/ setbacks from the system should be provided with a branch pipe near each hydrant outlet(both internal & external) in a proper box to protect It from withering.
4. Down comer system should be connected to overhead tank (RCC or FRP) /Underground Tank of **10,000** ltrs capacity exclusively for firefighting purpose.
The Automatic Sprinkler system should be connected to overhead tank (RCC or FRP) /Underground Tank of **10,000** ltrs capacity.
5. The Down comer system should be connected to booster pump installed at the terrace level /underground tank capable of delivering 450 LPM.
The Sprinkler system should be connected to booster pump installed at the terrace level /underground tank capable of delivering 450 LPM.
6. Automatic Sprinkler System heads with one sprinkler head for every 6.96 Sq.mtrs in basement area of the building should be provided.
7. Manually operated electrical fire alarm system with call point should be installed in



each floor at appropriate places. The call boxes are of "break glass" type, where the call is transmitted automatically to the control room when the glass of the system is broken. This system should be connected to an alternative source of power supply (diesel generator). The call boxes are so installed that their location can be easily noticed from either direction and at a height of one meter from the floor level.

8. Public address system with two ways communication facility should be provided, with its console at the control room, located on the ground floor near the entrance of the building.
9. Fire control room should be provided at entrance of the ground floor with P.A Console & MCP control panel should be installed in fire control room.
10. Directions in which the students have to move in the event of any emergency should be displayed in the corridor on each floor during evacuation.
11. A Fire Siren should be installed inside the premises to inform all the inmates in case of a fire emergency and evacuate the area.
12. COTPA Sec-4, direction NO Smoking area smoking here is an offence board should be written in English & Kannada both language shall be prominently displayed at inside the entry / exit of the each floor.
13. One non-teaching/teaching staff should be nominated as fire nodal officer for the education premises.
14. A notice board have been indicated the action should be taken by the employees in case of any emergency should be displayed with the telephone number of Banashankari Fire Station & 101, 500, 550, & 600 and the nearest Ambulance service and Police Station.
15. Electrical cables on Terminator points in the electrical panel and distribution boxes should be coated with certified Transparent Fire Retardant Coating.
16. 40% of the staffs/Teachers shall be get trained in fire prevention, fire fighting & evacuation at R.A.Mundkur fire & emergency service Academy, Bannerghatta road, Bengaluru-560 029.

Note: -

1. This is only the "Fire Advisory certificate" issued by the Fire Department from fire safety view of the already constructed Building. This shall not be considered as No Objection Certificate for the Building.
2. After completion of all the fire fighting installations as advised in Fire Advisory Certificate, 'Fire Advisory Compliance Certificate' shall be obtained from the Fire and Emergency department.


REGIONAL FIRE OFFICER
Bengaluru South Range.
Bengaluru - 560 029

Copy to the DGP & DG, KSFES Bangalore.


-for your kind Information sir.

1) District Fire Officer, Banashanakari Fire Station, Bengaluru.



ಚಲನ್ ಚಾಲ್ತಿ ಅವಧಿ Challan Validity	ಜಿಲ್ಲೆ District	ಇಲಾಖೆ Department	ಡಿಡಿಓ ಕಚೇರಿ DDO Office	
7 Days	BENGALURU URBAN	DEPARTMENT OF KARNATAKA FIRE & EMERGENCY SERVICES	DIVISIONAL FIRE OFFICE, KARNATAKA FIRE AND EMERGENCY SERVICES, BANGALORE SOUTH RANGE, BANGALORE	
ವರ್ಗ Category	ದಿನಾಂಕ Date	ಚಲನ್ ಉಲ್ಲೇಖ ಸಂಖ್ಯೆ Challan Reference Number	ಡಿಡಿಓ ಕೋಡ್ DDO Code	
Government	30/05/2026	CR0526007000313172	140050	
ಸಂದಾಯದಾರನ ಹೆಸರು Remitter Name	Bangalore International KidsHigh		ಮೊಬೈಲ್ ಸಂಖ್ಯೆ Mobile Number	8105719555
ವಿಳಾಸ Address	No. 20/A, 1st Main, New Sapthagiri Layout, Uttharahalli Main Road, Subramanyapura, Bengaluru 560061			
ಉದ್ದೇಶ Purpose	ಲೆಕ್ಕ ಶೀರ್ಷಿಕೆ Head of Account	ಉಪ ಉದ್ದೇಶದ ಹೆಸರು Sub Purpose Name	ಉದ್ದೇಶ ನಿರ್ದಿಷ್ಟ ಐಡಿ Purpose Specific ID	ಮೊತ್ತ Amount
COLLECTION OF FEES AND OTHER RECEIPTS FROM FIRE DEPARTMENT	0070~60~109~0~02~000	12.FOR ISSUE OF ADVISE ON FIRE PREVENTION AND FIRE FIGHTING FOR NON HIGH RISE BUILDINGS.	NA--	22000
ಸಂದಾಯದ ಬ್ಯಾಂಕ್ Remittance Bank	STATE BANK OF INDIA	ಒಟ್ಟು ಮೊತ್ತ Grand Total	22000	
ಪಾವತಿ ಹಂತ Payment Status	Payment Yet To Be Made At Agency Bank	ಒಟ್ಟು ಮೊತ್ತ ಅಕ್ಷರಗಳಲ್ಲಿ Total Amount in Words	Twenty Two Thousand Only	
ಪಾವತಿ ವಿವರಗಳು Payment Details				
ಪಾವತಿ ವಿಧ Payment Mode	Cash			

J-270390167

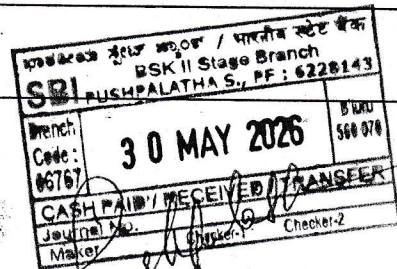

Remitter's copy



119-E



ಚಲನ್ ಚಾಲ್ತಿ ಅವಧಿ Challan Validity	ಜಿಲ್ಲೆ District	ಇಲಾಖೆ Department	ಡಿವಿಷನ್ ಕಚೇರಿ DDO Office	
7 Days	BENGALURU URBAN	DEPARTMENT OF KARNATAKA FIRE & EMERGENCY SERVICES	DIVISIONAL FIRE OFFICE, KARNATAKA FIRE AND EMERGENCY SERVICES, BANGALORE SOUTH RANGE, BANGALORE	
ವರ್ಗ Category	ದಿನಾಂಕ Date	ಚಲನ್ ಉಲ್ಲೇಖ ಸಂಖ್ಯೆ Challan Reference Number	ಡಿವಿಷನ್ ಕೋಡ್ DDO Code	
Government	30/05/2026	CR0526007000313115	140050	
ಸಂದಾಯದಾರನ ಹೆಸರು Remitter Name	Bangalore International PublicSchool		ಮೊಬೈಲ್ ಸಂಖ್ಯೆ Mobile Number	7338666444
ವಿಳಾಸ Address	No. 58/2, Subramanyapura Main Road, Chikkallasandra, Bangalore 560061			
ಉದ್ದೇಶ Purpose	ಲೆಕ್ಕ ಶೀರ್ಷಿಕೆ Head of Account	ಉಪ ಉದ್ದೇಶದ ಹೆಸರು Sub Purpose Name	ಉದ್ದೇಶ ನಿರ್ದಿಷ್ಟ ಐಡಿ Purpose Specific ID	ಮೊತ್ತ Amount
COLLECTION OF FEES AND OTHER RECEIPTS FROM FIRE DEPARTMENT	0070~60~109~0~02~000	12.FOR ISSUE OF ADVISE ON FIRE PREVENTION AND FIRE FIGHTING FOR NON HIGH RISE BUILDINGS.	NA--	22000
ಸಂದಾಯದ ಬ್ಯಾಂಕ್ Remittance Bank	STATE BANK OF INDIA	ಒಟ್ಟು ಮೊತ್ತ Grand Total	22000	
ಪಾವತಿ ಹಂತ Payment Status	Payment Yet To Be Made At Agency Bank	ಒಟ್ಟು ಮೊತ್ತ ಅಕ್ಷರಗಳಲ್ಲಿ Total Amount in Words	Twenty Two Thousand Only	
ಪಾವತಿ ವಿವರಗಳು/Payment Details				
ಪಾವತಿ ವಿಧ Payment Mode	Cash			

J - 26944285

